


PEMC Market Assessment Highlights

- The average demand, including the average reserve schedule, was recorded at 10,417 MW on 27 October 2020. The Modified Enhanced Community Quarantine (MECQ), General Community Quarantine (GCQ) and the Modified General Community Quarantine (MGCQ) are in place to contain the spread of the coronavirus disease. Starting 20 October – Lanao del Sur and 23 barangays in Cataman, Northern Samar are under the MECQ; the rest of Northern Samar, National Capital Region, Batangas, Iloilo City, Bacolod City, Tacloban City and Iligan City are under the GCQ; and the rest of the country is under the MGCQ.
- The total WESM registered capacity stood at 20,206 MW.
- The outage capacity averaged 4,161 MW. About 35% of which involved coal plants while about 45% involved natural gas plants. About 92% of the total outage capacity were from forced outages.
- The average effective supply of 11,952 MW was about 10% lower than 13,316 MW a week ago mainly due to the outage of multiple generating units affected by Typhoon Quinta.
- A supply margin averaging 1,535 MW was observed.
- The average GWAP for the day was at PhP 6,056/MWh, which was higher than the previous day's PhP 1,259/MWh and higher than the previous Tuesday's PhP 1,492/MWh. The sharp increase was mainly caused by the drop in effective supply due to Typhoon Quinta.
- The secondary price cap was not imposed during the day.
- The top 5 major participant groups accounted for 76% of the average offered capacity. The Herfindahl-Hirschman Index (HHI) by major participant grouping indicated a moderately concentrated market based on the registered capacity, registered capacity (net of outage) and the offered capacity.
- During the day, the following were the pivotal suppliers: Masinloc CFTPP (about 21% of the time), Kalayaan PSPP (about 13% of the time), Pagbilao CFTPP (about 13% of the time), Sta. Rita NGPP (about 13% of the time) and Sual CFTPP (about 4% of the time).


IEMOP Market Systems Advisory

- No IT-related issue was encountered in IEMOP's market systems on 27 October 2020.

CAPACITY PROFILE (EX-ANTE)

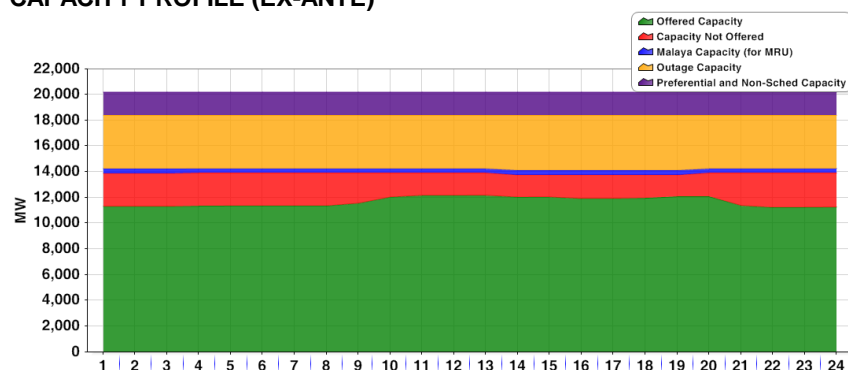


OUTAGE CAPACITY BY PLANT TYPE

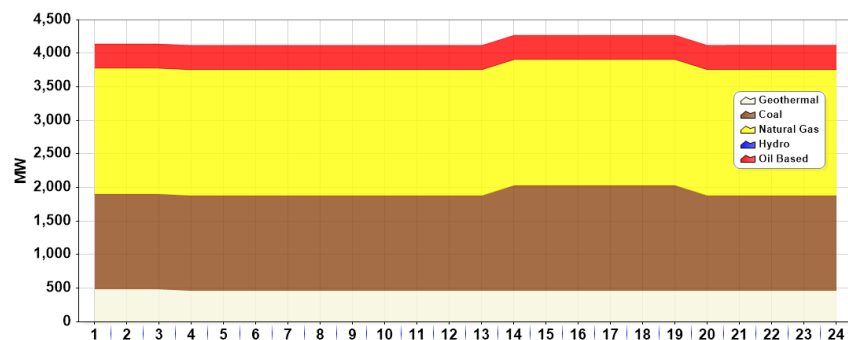


Summary of Prices, Demand and Supply

Particulars		Today	Prev Day	SameDay Prev wk	Percent Change From	
		27-Oct	26-Oct	20-Oct	prev day	same day last week
GWAP (PhP/MWh)	max	19,185.48	2,032.84	1,663.84	843.78%	1,053.09%
	min	1,360.14	-9.82	1,146.64	13,951.62%	18.62%
	ave	6,055.95	1,258.67	1,492.37	381.14%	305.80%
EFFECTIVE Supply (MW)	max	12,941.69	12,726.18	14,411.23	1.69%	-10.20%
	min	11,187.13	11,326.63	12,368.29	-1.23%	-9.55%
	ave	11,951.67	11,916.92	13,316.07	0.29%	-10.25%
System Demand (MW)	max	10,849.94	9,100.42	10,920.74	19.22%	-0.65%
	min	7,361.05	6,569.88	8,384.65	12.04%	-12.21%
	ave	9,269.54	8,195.90	9,587.62	13.10%	-3.32%
DEMAND (ENERGY + RESERVE SCHED) (MW)	max	11,985.44	10,186.63	12,328.34	17.66%	-2.78%
	min	8,395.35	7,463.08	9,423.85	12.49%	-10.91%
	ave	10,417.01	9,257.34	10,805.47	12.53%	-3.60%
SUPPLY MARGIN (MW)	max	2,827.95	4,098.21	3,135.25	-31.00%	-9.80%
	min	632.27	1,693.33	1,896.61	-62.66%	-66.66%
	ave	1,534.66	2,659.59	2,510.60	-42.30%	-38.87%


SUPPLY, DEMAND AND PRICE

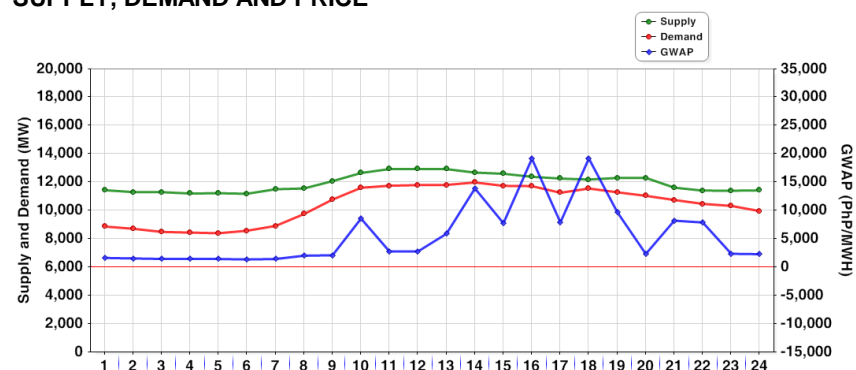


OUTAGE BY PLANT TYPE

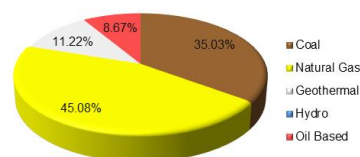


OUTAGE BY CATEGORY

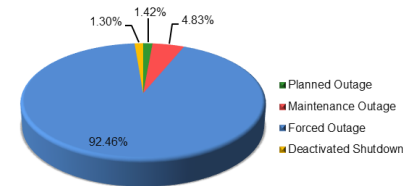


SECONDARY CAP

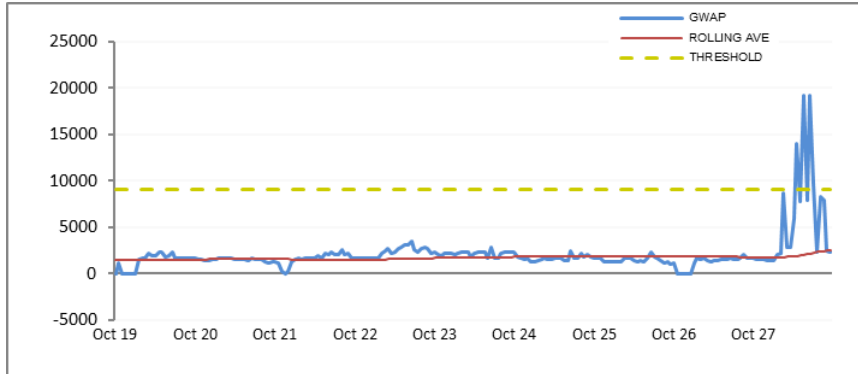


DAILY AVERAGE PRICES AND VARIANCE

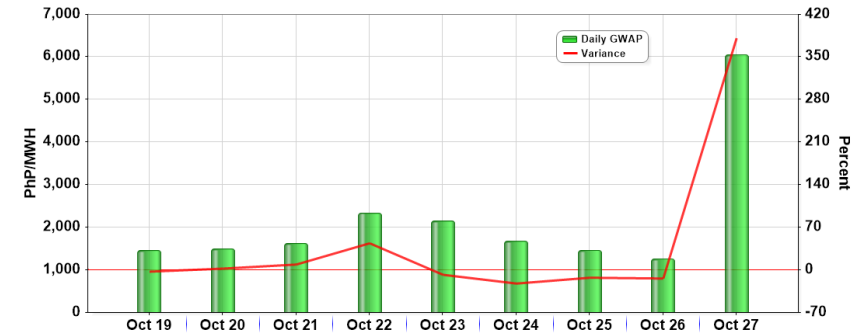


MARKET RSI VS PIVOTAL PLANTS BASED ON EFFECTIVE SUPPLY

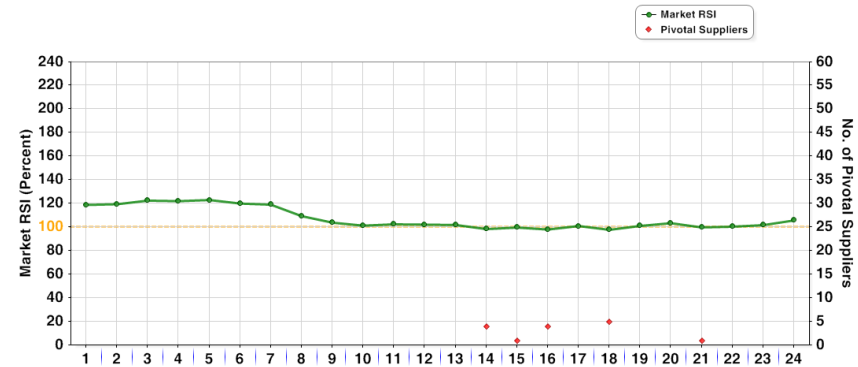


PIVOTAL PLANTS BASED ON EFFECTIVE SUPPLY (EX-ANTE)

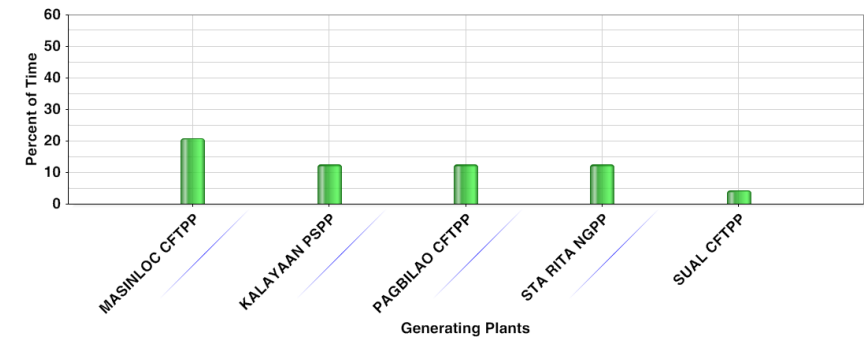

MARKET SHARE OF PARTICIPANT GROUPS

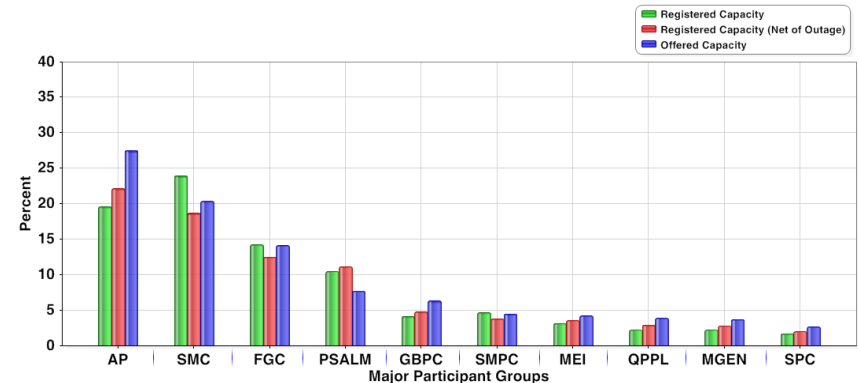

HERFINDAHL-HIRSCHMAN INDEX BASED ON PARTICIPANT GROUPS

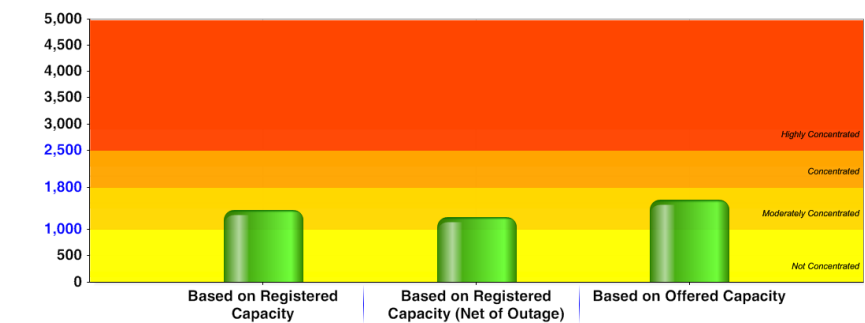

GLOSSARY OF TERMS

HERFINDAHL-HIRSCHMAN INDEX (HHI) - is a commonly accepted measure of market concentration that takes into account the relative size and distribution of participants in the market. The HHI is a number between 0 and 10,000, which is calculated as the sum of squares of the participant's market share. The HHI approaches zero when the market has very large number of participants with each having a relatively small market share. In contrary, the HHI increases as the number of participants in the market decreases, and the disparity in the market shares among the participants increases. The following are the widely used HHI screening numbers: (1) less than 1,000 - not concentrated; (2) 1,000 to 1,800 - moderately concentrated; (3) greater than 1,800 - concentrated; and (4) greater than 2,500 - highly concentrated.

The HHI is calculated using the (i) registered capacity, (ii) registered capacity net of outage, (iii) offered capacity, (iv) metered quantity, and (v) spot transaction (metered quantity net of bilateral contract declarations).

MARKET RESIDUAL SUPPLY INDEX (Market RSI) - The RSI is a dynamic continuous index measured as ratio of the available generation without a generator to the total generation required to supply the demand. The RSI is measured for each generator. The greater the RSI of a generator, the less will be its potential ability to exercise market power and manipulate prices, as there will be sufficient capacity from the other generators. In contrary, the lower the RSI, the greater the market power of a generator (and its potential benefit of exercising market power), as the market is strongly dependent on its availability to be able to fully supply the demand. In particular, a RSI greater than 100% for a generator means that the remaining generators can cover the demand, and in principle that generator cannot manipulate market price. On the other hand, a RSI less than 100% means that the generator is pivotal in supplying the demand.

The RSI for the whole market (Market RSI) is measured as the lowest RSI among all the generators in the market. A Market RSI less than 100% indicates the presence of pivotal generator/s.

PRICE SETTING FREQUENCY INDEX (PSFI) - A generator trading node is considered as a price setter when its last accepted offer price is between 95% to 100% of its nodal price. A generating plant is considered as price setter if at least one of its trading nodes was price setter in a given trading hour. The price setters are determined from: (i) ex-ante for trading intervals without pricing error during ex-ante, (ii) ex-post with pricing error during ex-ante but without pricing error during ex-post, (iii) market re-run results for trading intervals with pricing error both in ex-ante and ex-post, and (iv) trading intervals where the price substitution methodology (PSM) was applied. For trading intervals affected by PSM, the unconstrained marginal plants are considered price setters. Further, in instances of regional price separation, price setters are determined separately for each region.

3/3

DISCLAIMER: The information contained in this document is based on the available electricity spot market data. The same information is subject to change as updated figures come in. As such, the PEMC does not make any representation or warranty as to the completeness of this information. The PEMC likewise accepts no responsibility or liability whatsoever for any loss or cost incurred by a reader arising from, or in relation to, any conclusion or assumption derived from the information found herein.

MARKET SHARE - The fraction of the total capacity or energy that a company or related group owns or controls in the market.

PIVOTAL SUPPLIER FREQUENCY INDEX (PSI) - The pivotal supply index is a binary variable (1 for pivotal and 0 for not pivotal) for each generator. The index identifies whether a generator is pivotal in supplying the demand. The PSI is calculated as the percentage of time that a generator is pivotal in a period (i.e. monthly).

CAPACITY FACTOR - The index assesses the performance of the generators in the market. A high capacity factor indicates the high utilization of the generators.

CAPACITY PROFILE - The hourly factors affecting supply, which include, among others, the offered capacity, outage capacity and ancillary services schedule.

MAJOR PARTICIPANT GROUP - The grouping of generators by ownership or control.

REGISTERED CAPACITY - The capacity registered by a generator with WESM.

REGISTERED CAPACITY (NET OF OUTAGE) - The capacity registered by a generator with WESM less capacity on outage.

OFFERED CAPACITY - The hourly offer to supply electricity submitted by a generator.

METERED QUANTITY - The hourly quantity of electricity generated by a generator.

SPOT TRANSACTION - The hourly quantity of electricity sold to the market by a generator net of bilateral contract declaration accounted for in the settlement.

ANCILLARY SERVICES SCHEDULES - The hourly quantity scheduled by the System Operator to provide regulating, contingency and dispatchable reserves.

EFFECTIVE SUPPLY - The hourly effective supply is equal to the offered capacity of all scheduled generator resources, nominated loading level of non-scheduled generating units and projected output of preferential dispatch generating units, adjusted for any security limit provided by the System Operator and other constraints considered during MMS simulation such as generator offered ramp rates. Scheduled output of plants on testing and commissioning through the imposition of security limit by SO and scheduled output of Malaya plant when it is called to run as Must Run Unit (MRU) are likewise accounted for in the effective supply.