

RULES CHANGE COMMITTEE

Proposed Amendments to Various WESM Manuals for Improvements to Market Resource Modelling and Monitoring



Effective Date : 15 October 2021

Page : 1 of 23

WHEREAS, the WESM Manuals on 1) Market Network Model Development and Maintenance – Criteria and Procedures Issue 4.2 (MNMCP Manual) and 2) Registration, Suspension and De-Registration Criteria and Procedures Issue 5.3 (RSDCP Manual) provide the procedures for registration of market resources and corresponding changes to the market network model (MNM);

WHEREAS, on 23 March 2021, the Independent Electricity Market Operator of the Philippines (IEMOP) submitted proposed amendments to the MNMCP and RSDCP Manuals to refine and clarify the modelling of market resources in the MNM and to provide additional features in the modelling of generators;

WHEREAS, the RCC took up the proposal during its 177th Regular Meeting on 16 April 2021 and approved to post the proposal in the Philippine Electricity Market Corporation (PEMC) website, as submitted, to solicit comments from WESM Members and stakeholders;

WHEREAS, following the 30-working day commenting period from 21 April 2021 to 03 June 2021, the PEMC, WESM Technical Committee (TC), Millennium Energy Inc. (MEI), Panasia Energy Inc. (PEI), Aboitiz Power Corporation (APC), and Manila Electric Company (MERALCO) submitted their comments which were responded to by the proponent and were considered in RCC's deliberations;

WHEREAS, the National Grid Corporation of the Philippines (NGCP) submitted its comments on 05 July 2021, which is beyond the commenting period, but was nevertheless considered for discussion by the RCC during its 181st Regular Meeting held on 16 July 2021;

WHEREAS, during several RCC meetings¹, the RCC agreed on the following:

- (1) Include the Provisional Authority to Operate (PAO) or Energy Regulatory Commission (ERC) Certificate with appropriate exhibit as bases for the generator's registered capacity (Pmax), in addition to the Certificate of Compliance (COC) also issued by the ERC;
- (2) The responsibility for ensuring accurate and complete real-time data falls under the System Operator, in coordination with Network Service Providers and Trading Participants. The Market Operator and the System Operator will develop a standard to determine the acceptable level of completeness, availability, and accuracy of data, which will be submitted as proposed amendments to the WESM Manual on Dispatch Protocol;

¹ The proposal was discussed during the 180th, 181st, 182nd, 183rd and 184th RCC Meetings held on 18 June 2021, 16 July 2021, 23 July 2021, 20 August 2021 and 17 September 2021, respectively.

Proposed Amendments to Various WESM Manuals for Improvements to Market Resource Modelling and Monitoring

- (3) The result of market impact study conducted by the Market Operator under Section 4.6.3 of the MNMCP Manual shall be submitted to the DOE, ERC and PEM Board, and may be posted in the market information website at their discretion;
- (4) Include the reporting of real-time monitoring facilities owned by the System Operator that have been persistently erroneous or non-updating and the period to resolve the erroneous data which will be within fifteen (15) days for both the Trading Participant and the System Operator;
- (5) Include the coordination of the System Operator with the Market Operator and Trading Participant in estimating real-time data that was reported as erroneous or non-updating; and
- (6) The Market Operator may provisionally model the generating unit at the nearest MNM substation to which it is indirectly connected following the illustration of Simplified Model for Embedded Generators under Section 5.3.2 of the MNMCP Manual;

WHEREAS, the RCC noted the objections of Mr. Ambrocio R. Rosales (SO) and Prof. Jordan P. Orillaza (Technical Committee Chairperson) on the abovementioned illustration of Simplified Model for Embedded Generators. Mr. Rosales opined that the illustration appears to be radial which is not equivalent to the actual network that is being simplified and suggested using a pseudo-line in looping the substations for such network connection. Meanwhile, Prof. Orillaza posited that the proposed provision on simplifying the network is not technically sound as it should be illustrated using power flows;

WHEREAS, as requested by Mr. Ryan S. Morales (Distribution Sector), the RCC also noted the number of cases where such simplification is being done, as follows:

Region	No. of Registered Generators (as of 20 Aug 2021)	No. of Registered Generators Modelled at Nearest Substation
Luzon	185	73 (39%)
Visayas	87	54 (62%)

WHEREAS, the RCC also noted IEMOP's response, as relayed by Mr. Edward I. Olmedo (IEMOP Representative), that the proposal reflects the current market network modelling process of the Market Operator and that the IEMOP will submit another proposal by December 2021 enhancing the market network simplification process to address the issues raised by the SO and Technical Committee Chairperson and on the modelling of embedded generators;

WHEREAS, the RCC during its 185th meeting on 15 October 2021 finalized the proposal and approved its endorsement to the PEM Board;²

³ 5.5.1 Within two (2) working days from deployment, the Market Operator shall publish advisory on the MNM updates deployed in the production system. Consistent with the provisions of Clause 4.5.7 of this Market Manual, the Market Operator shall prepare a monthly report containing all MNM updates deployed in the production system. This report shall be provided to the DOE, ERC, and the PEM Board, and shall be similarly published in the market information website ten (10) working days after the end of the billing period. At the least, it shall contain the following:

Proposed Amendments to Various WESM Manuals for Improvements to Market Resource Modelling and Monitoring




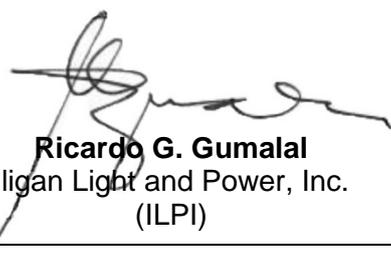
NOW THEREFORE, we, the undersigned, on behalf of the sectors we represent, hereby resolve *via* electronic communication platform, as follows:

RESOLVED, that the RCC approves the Proposed Amendments to WESM Manuals on Market Network Model Development and Maintenance – Criteria and Procedures Issue 4.2 and on Registration, Suspension and De-Registration Criteria and Procedures Issue 10.0 for Improvements to Market Resource Modelling and Monitoring (Annex);

RESOLVED FURTHER, that the said Proposed Amendments to the WESM Manuals on Market Network Model Development and Maintenance – Criteria and Procedures Issue 4.2 and on Registration, Suspension and De-Registration Criteria and Procedures Issue 10.0 for Improvements to Market Resource Modelling and Monitoring are hereby endorsed to the PEM Board for approval and subsequent transmittal to the DOE for promulgation.

Done this 15th day of October 2021 *via* Microsoft Teams.

Proposed Amendments to Various WESM Manuals for Improvements to Market Resource Modelling and Monitoring

<p>Approved by: THE RULES CHANGE COMMITTEE</p>	
<p>Independent Members:</p>	
<p>Maila Lourdes G. de Castro Chairperson</p>	 Francisco L.R. Castro, Jr.
 Allan C. Nerves	 Concepcion I. Tanglao
<p>Generation Sector Members:</p>	
 Dixie Anthony R. Banzon Masinloc Power Partners Co. Ltd. (MPPCL)	 Cherry A. Javier Aboitiz Power Corp. (APC)
 Carlito C. Claudio Millennium Energy, Inc./ Panasia Energy, Inc. (MEI/PEI)	 Mark D. Habana Vivant Corporation - Philippines (Vivant)
<p>Distribution Sector Members:</p>	
 Virgilio C. Fortich, Jr. Cebu III Electric Cooperative, Inc. (CEBECO III)	 Ryan S. Morales Manila Electric Company (MERALCO)
 Ricardo G. Gumalal Iligan Light and Power, Inc. (ILPI)	 Nelson M. Dela Cruz Nueva Ecija II Area 1 Electric Cooperative, Inc. (NEECO II – Area 1)

ASH

<p>Supply Sector Member:</p>
 Lorreto H. Rivera Team (Philippines) Energy Corporation (TPEC)
<p>Market Operator Member:</p>
 Isidro E. Cacho, Jr. Independent Electricity Market Operator of the Philippines (IEMOP)
<p>System Operator Member:</p>
 Ambrocio R. Rosales National Grid Corporation of the Philippines (NGCP)



A. WESM Manual on Registration, Suspension and De-Registration Criteria and Procedures Issue 10.0

Title	Clause	Provision	Proposed Amendment	Rationale
Other Considerations	2.5.4.2.	<p>Aggregation of Generating Units</p> <p><i>A Generation Company that owns multiple generating units located in a single generating station shall, upon application, inform the Market Operator if it wishes to have an aggregated representation for such generating units in the market network model. The Applicant, the Network Services Provider, Metering Services Provider, System Operator and the Market Operator shall agree on the manner of aggregated representation in accordance with the procedures set forth in relevant Market Manuals.¹⁶</i></p>	<p>Aggregation of Generating Units</p> <p><i>A Generation Company that owns multiple generating units located in a single generating station shall, upon application, inform the Market Operator if it wishes to have an aggregated representation for such generating units in the market network model.</i></p> <p><i>The Applicant, the Network Services Provider, Metering Services Provider, System Operator and the Market Operator shall agree on the manner of aggregated representation in accordance with the procedures set forth in relevant Market Manuals.¹⁶</i></p> <p><u>Should the technical information contained in the Certificate of Compliance or Provisional Authority to Operate (PAO) or ERC Certificate with appropriate exhibit issued by the ERC indicate details per generating unit, the following shall be observed when reflecting the aggregated facility's registered capacity:</u></p>	To clarify how Pmin and Pmax are determined for aggregated generating units

Title	Clause	Provision	Proposed Amendment	Rationale
			<p>a. <u>Maximum Stable Load (or Pmax) shall be based on the sum of the individual generating unit's maximum capacity; and</u></p> <p>b. <u>Minimum Stable Load (or Pmin) shall be based on the smallest Pmin among the individual generating units.</u></p>	
Other Considerations	2.5.4.7	(NEW)	<p><u>2.5.4.8 Real-Time Monitoring Location</u></p> <p><u>During the registration of the generating unit, the Generation Company shall specify if its real-time monitoring will be at the gross MW output of the generating unit or at the same location as its market trading node, which is at its connection point and net of its station use, in accordance with the guidelines set forth in the WESM Manual on Market Network Model Development and Maintenance – Criteria and Procedures.</u></p>	To require the generation company to provide the Market Operator information on the location of its real-time monitoring facilities to more efficiently facilitate its accurate inclusion in the MNM

B. WESM Manual on Market Network Model Development and Maintenance - Criteria and Procedures Issue 4.2

Title	Clause	Provision	Proposed Amendment	Rationale
Definitions	2.1.5	(NEW)	<u>2.1.5 Market Resource refers to the objects defined in the Market Network Model to represent generators, battery energy storage systems, pumped-storage units, and loads.</u>	To provide general term used in MNM for all objects representing generators, BESS, pumped-storage units, and loads The market resource is the actual objects being modelled in the system.
Responsibilities	3.2.2	(NEW)	<u>3.2.2 The System Operator and the Generation Companies shall ensure that their facilities for real-time monitoring are available and that they accurately reflect the state of their generation (i.e., MW/MVAR output and generator breaker status).</u>	To include Generator Companies in the responsibility to maintain real-time facilities to cover cases when the Generation Company owns or manages its own real-time monitoring facilities
Responsibilities	3.2.3	(NEW)	<u>3.2.3 The Market Operator shall immediately inform the System Operator of any observed discrepancies in the real-time data.</u>	To provide separate responsibility for IEMOP to report any observed discrepancies in the real-time data from SO
Criteria for The Market Network Model Development	4.3.2	Network data that accurately reflects the conditions prevailing on the network, including losses, constraints and contingencies, at any trading interval	Network data that accurately reflects the conditions prevailing on the network, including losses, constraints and contingencies, at any trading dispatch interval	Revised the term “trading interval” to “dispatch interval” for consistency with the use of dispatch intervals

Title	Clause	Provision	Proposed Amendment	Rationale
MNM Components and Modeling	4.4.2	<p>Generator plant/unit representations</p> <p>These are numerical representations of generating units and its characteristics corresponding to power injection to the network. Generating units shall be modeled as the positive power injection with linear monotonically increasing cost function.</p>	<p><u>Representations of</u> Generator plant/unit representations <u>Market Resources</u></p> <p>These are numerical representations of generating units and its characteristics corresponding to power injection to the network. Generating units shall be modeled as the positive power injection with linear monotonically increasing cost function.</p>	To reflect the general term for representations of generators, battery energy storage systems, pumped-storage unit, and loads
MNM Components and Modeling	4.4.3	<p>Load representations</p> <p>These are numerical representations of the customer demand corresponding to power withdrawal from the network. Loads shall be modeled as constant power withdrawal points.</p>	<p><u>Representations of</u> Load representations <u>Market Resources</u></p> <p>These are numerical representations of the customer demand corresponding to power withdrawal from the network. Loads shall be modeled as constant power withdrawal points.</p>	To reflect the general term for representations of generators, battery energy storage systems, pumped-storage unit, and loads
MNM Components and Modeling	4.4.4	<p><i>Battery Energy Storage System</i> representation</p> <p>This is the mathematical model of a <i>battery energy storage system</i> with its dual capability of injecting or withdrawing power through the network.</p>	<p><u>Representations of</u> <i>Battery Energy Storage System</i> representation <u>Market Resources</u></p> <p>This is the mathematical model of a <i>battery energy storage system</i> with its dual capability of injecting or withdrawing power through the network.</p>	To reflect the general term for representations of generators, battery energy storage systems, pumped-storage unit, and loads
MNM Components and Modeling	4.4.5	<p><i>Pumped-Storage Unit</i> representation</p> <p>This is the mathematical model of a <i>pumped-storage unit</i> with its dual capability of injecting or withdrawing power through the network.</p>	<p><u>Representations of</u> <i>Pumped-Storage Unit</i> representation <u>Market Resources</u></p> <p>This is the mathematical model of a <i>pumped-storage unit</i> with its dual capability of injecting or withdrawing power through the network.</p>	To reflect the general term for representations of generators, battery energy storage systems, pumped-storage unit, and loads

Title	Clause	Provision	Proposed Amendment	Rationale
MNM Components and Modeling	4.4.7	<p>Transshipment Node</p> <p>A node in the network model that has neither a generator nor customer associated to it. A transshipment node connects at least two equipments together.</p>	<p>Transshipment Node</p> <p>A node in the network model that has neither a generator nor customer associated to it. A transshipment node connects at least two equipments together.</p>	<p>Clerical correction for equipment</p>
Market Impact Study	4.6.3	<p>The Market Operator shall publish the results of the market impact study as may be required by the PEM Board.</p>	<p>The <i>Market Operator</i> shall publish submit the results of the market impact study as may be required by to the DOE, ERC, and the PEM Board.</p> <p><u>The Market Operator shall publish a public copy of the same in the market information website, if required by the DOE, ERC, or the PEM Board.</u></p>	<p>To include the DOE, ERC and PEM Board as recipient of the study</p> <p>For transparency</p>
MNM	5	<p>ALTERATIONS TO THE MARKET NETWORK MODEL</p>	<p>ALTERATIONS UPDATING AND MAINTENANCE OF TO THE MARKET NETWORK MODEL</p>	<p>Revised for clarity</p>
Network Development	5.2.2	<p>Changes in the MNM configuration as a result of network development or aggregation or disaggregation of Trading Nodes shall be published in accordance with MNM publication requirements set forth in Section 6.0 of this document.</p>	<p>Changes Updates in the MNM configuration as a result of the network development or aggregation or disaggregation of Trading Nodes market resources shall be made published in accordance with the MNM publication requirements set forth in Section 6.0 5.5 of this document Market Manual.</p>	<p>Revised for clarity</p> <p>To correct the reference on the manner of publication in case of changes/updates in the MNM</p>
Simplifications on the Market Network Model	5.3.2	<p>The MNM may contain simplifications related to the representation of Generation and Customer Trading Nodes upon request of a Trading Participant and approved by the</p>	<p>The MNM may contain simplifications related to the representation of Generation and Customer Trading Nodes market resources upon request of a <i>Trading Participant</i>. It should be and</p>	<p>Revised for clarity</p> <p>Included provision on the treatment of Generators (e.g.</p>

Title	Clause	Provision	Proposed Amendment	Rationale
		<p>Market Operator, System Operator, and if necessary, the Network Service Provider. Such simplifications are listed, but not limited to the following conditions</p> <p>a) Aggregated representation of multiple generating units;</p> <p>b) Aggregated representation in the MNM may be applied to multiple generating units that are located in a single generating station;</p> <p>c) Disaggregated representation of customer trading nodes; and</p> <p>d) Single Customer Trading Nodes representing an aggregate of multiple customers maybe disaggregated into several Customer Trading Nodes corresponding to the customers represented in that Trading Node. It is provided, however, that such disaggregation shall be allowed only in cases where there are appropriate real-time monitoring points that can account for the real-time withdrawal of energy in each disaggregated individual customer trading node.</p>	<p>approved <u>agreed upon</u> by the <i>Trading Participant, Market Operator, System Operator,</i> and if necessary, the <i>Network Service Provider.</i> Such simplifications are listed, but not limited to the following conditions-;</p> <p>a) Aggregated representation of multiple generating units;</p> <p>b) <u>(note: aggregated representation in the MNM may be applied to multiple <i>generating units</i> that are located in a single generating station);</u></p> <p>eb) Disaggregated representation of customer trading nodes; and</p> <p>ec) Single Customer Trading Nodes representing an aggregate of multiple customers maybe disaggregated into several Customer Trading Nodes corresponding to the customers represented in that Trading Node. It is provided, however, that such disaggregation shall be allowed only in cases where there are appropriate real-time monitoring points that can account for the real-time withdrawal of energy in each disaggregated individual customer trading node.</p> <p><u>d) Representation of downstream <i>generating units</i> with limited real-time monitoring facilities such as in cases of embedded generators where there is limited availability</u></p>	<p>Embedded Generators) that are located far from the main substation of NGCP, and there is limited real-time monitoring facilities available, or when they are in distribution networks that are not modelled in the MNM.</p> <p>To reflect the current practice of IEMOP in simplifying actual network configurations</p>

Title	Clause	Provision	Proposed Amendment	Rationale
			<p><u>of real-time monitoring facilities between the transmission system’s main substation and the generator, in which case, the Market Operator may provisionally model the generating unit at the nearest MNM substation to which it is indirectly connected. The following illustration shows an example of this case:</u></p> <p><i>[See Appendix A.]</i></p> <p><u>e) Representation of downstream generating units located in a distribution network that is not reflected in the market network model. The Market Operator may model the generating unit at the nearest MNM substation to which it is indirectly connected.</u></p>	
	5.5.2	5.5.2 The Market Operator shall regularly publish the relevant updated MNM documents within seven days after the completion of the	The Market Operator shall regularly publish the relevant updated MNM documents within seven days after the completion of the MNM	Redundant provision. Regular reporting is already covered in Section 5.5.1. ³

³ 5.5.1 Within two (2) working days from deployment, the Market Operator shall publish advisory on the MNM updates deployed in the production system. Consistent with the provisions of Clause 4.5.7 of this Market Manual, the Market Operator shall prepare a monthly report containing all MNM updates deployed in the production system. This report shall be provided to the DOE, ERC, and the PEM Board, and shall be similarly published in the market information website ten (10) working days after the end of the billing period. At the least, it shall contain the following:

Title	Clause	Provision	Proposed Amendment	Rationale
		MNM consistency monitoring in the MMS' production system. Every revision of the MNM shall have the following associated documents published in the Market Information Website: a) MNM Revisions Manual; b) Bus-Oriented Single Line Diagram; and c) Information brief	consistency monitoring in the MMS' production system. Every revision of the MNM shall have the following associated documents published in the Market Information Website: a) MNM Revisions Manual; b) Bus-Oriented Single Line Diagram; and c) Information brief	
	5.5.3	All publication by the Market Operator regarding the MNM shall be in an un-editable electronic format. The MNM documents shall be published to the general public through the Market Information Website.	5.5.3. <u>5.5.2</u> All publication by the Market Operator regarding the MNM shall be in an un-editable electronic format. The MNM documents shall be published to the general public through the Market Information Website.	Renumbering due to deletion of previous clause
MNM	--	MARKET NETWORK MODEL MAINTENANCE AND PUBLICATION	MARKET NETWORK MODEL MAINTENANCE AND PUBLICATION	Not necessary; clerical edit.
Continuing Obligations and Responsibilities	5.10.2	(NEW)	<u>5.10.2 The System Operator, in coordination with Network Service Providers and Trading Participants shall continuously ensure the completeness, availability, and accuracy of the required real-time data in the market network model.</u>	To highlight the responsibility of SO in ensuring reliability of real-time data The Market Operator and the System Operator will develop a standard to determine the acceptable level of completeness, availability, and accuracy of

- a) Summary of MNM Updates during the month
- b) Latest Bus-Oriented Single Line Diagram

Title	Clause	Provision	Proposed Amendment	Rationale
				data, which will be submitted as proposed amendments to the WESM Manual on Dispatch Protocol.
Continuing Obligations and Responsibilities	5.10.3	(NEW)	<u>5.10.3 The System Operator shall report real-time monitoring facilities owned or managed by the Trading Participants or owned by the System Operator that have been persistently erroneous or non-updating for at least two (2) business days to the Market Operator and Enforcement and Compliance Office. The Trading Participant shall endeavor to resolve the issue within fifteen (15) calendar days from the time it was reported.</u>	To ensure that the TP and SO will correct real-time data errors in a timely manner
Continuing Obligations and Responsibilities	5.10.4	(NEW)	<u>5.10.4 The System Operator in coordination with the Market Operator and Trading Participant shall estimate shall be responsible for estimating real-time data that was reported to be erroneous or non-updating.</u>	To ensure accuracy of scheduling and pricing
Continuing Obligations and Responsibilities	5.10.5	(NEW)	<u>5.10.5 The Market Operator shall immediately inform the System Operator of any observed discrepancies in the real-time data.</u>	To provide separate responsibility for IEMOP to report any observed discrepancies in the real-time data from SO
MNM	6	MARKET TRADING NODE	MARKET TRADING NODE <u>MODELLING OF MARKET RESOURCES</u>	To reflect the general term for representations of generators, battery energy storage systems, pumped-storage unit, and loads

Title	Clause	Provision	Proposed Amendment	Rationale
Market Trading Node	6.1.1	The Market Trading Node in the MNM, in physical terms, represents a power substation onto which energy is injected or withdrawn through power transformers or switching equipment. The transformers and switching equipment connect the transmission network operated by the System Operator and generating equipment, distribution network operated by Network Service Provider and load customers.	<p>The Market Trading Node in the MNM, in physical terms, represents a power substation onto which energy is injected or withdrawn through power transformers or switching equipment. The transformers and switching equipment connect the transmission network operated by the System Operator and generating equipment, distribution network operated by Network Service Provider and load customers.</p> <p><u>Market Resources shall be modelled in the market network model to represent a generator, battery energy storage system, pumped-storage unit, or load. Subject to Section 6.1.2, each market resource shall be classified as either a scheduling point or a market trading node of the generator, battery energy storage system, pumped-storage unit, or load.</u></p>	Revised for clarity
Market Trading Node	6.1.2	(NEW)	<p><u>It is possible to define only one market resource to represent both the scheduling point and the market trading node.</u></p>	Added to clarify that some market resources can represent both scheduling point and market trading node.
Market Trading Nodes	6.3	CLASSIFICATION OF MARKET TRADING NODES	<p>CLASSIFICATION TYPES OF MARKET TRADING NODES <u>RESOURCES</u></p>	Revised to use Market Resources as defined in proposed Section 2.1.5.

Title	Clause	Provision	Proposed Amendment	Rationale
Classification of Market Trading Nodes	6.3.1	<p>MTN's can be classified as:</p> <p>a) Generator nodes – nodes that represent a registered generating unit or generating system directly connected to a network operated by the System Operator. It is a node where power is injected into the transmission network.</p> <p>b) Customer nodes – nodes that represent where power is withdrawn by Trading Participants from the grid.</p> <p>c) Battery Energy Storage System nodes – nodes that represent a registered battery energy storage system directly connected to a network operated by the System Operator. It is a node where power is injected or withdrawn through the transmission network.</p> <p>d) Pumped-Storage Unit nodes – nodes that represent a registered pumped-storage unit directly connected to a network operated by the System Operator. It is a node where power is injected or withdrawn through the transmission network.</p>	<p>MTN's Market Resources can be classified as:</p> <p>a) Generator nodes resources – nodes resources that represent a registered generating unit or generating system directly connected to a network operated by the System Operator. It is a node resource where power is injected into the transmission network.</p> <p>b) Customer nodes resources – nodes resources that represent where power is withdrawn by Trading Participants from the grid.</p> <p>c) Battery Energy Storage System nodes resources – nodes resources that represent a registered battery energy storage system directly connected to a network operated by the System Operator. It is a node resource where power is injected or withdrawn through the transmission network.</p> <p>d) Pumped-Storage Unit nodes resources – nodes resources that represent a registered pumped-storage unit directly connected to a network operated by the System Operator. It is a node resource where power is injected or withdrawn through the transmission network.</p>	Replaced nodes with resources as defined in proposed Section 2.1.5.
Classification of Market Trading Nodes	6.3.2	Where available remote telemetering facilities are situated at a location net of the station service, the Trading Participant shall have a generator and a customer MTN registered in the WESM to accurately reflect the direction of power flow.	<u>For generating units registered and modelled net of its station use</u> Where available remote telemetering facilities are situated at a location net of the station service, the Trading Participant shall have a generator and a customer MTN	Revised for clarity

Title	Clause	Provision	Proposed Amendment	Rationale
			<u>resource</u> registered in the WESM to accurately reflect the direction of power flow.	
Market Trading Node	6.4	<p>CRITERIA FOR THE DEFINITION OF MTN</p> <p>The following are the general criteria for the definition of MTN:</p>	<p>CRITERIA FOR THE DEFINITION OF MTN <u>GUIDELINES FOR MODELLING A MARKET RESOURCE</u></p> <p>The following are the general criteria for the definition of MTN <u>guidelines in modelling the different market resources:</u></p>	Replaced MTN with Market Resource defined in proposed Section 2.1.5.
Criteria for the Definition of MTN	6.4.5	If the Trading Participant is a dispatchable generator connected to a distribution system (embedded facility), then its MTN and scheduling point shall be assigned to the nearest scheduling point represented in the MNM. Adjustments to the real-time monitoring of the Customer scheduling point shall be made accordingly to reflect the total power consumed by that Customer scheduling point accounting for the power generated by the dispatchable generator situated downstream.	<p>If the Trading Participant is a dispatchable generator connected to a distribution system (embedded facility), then its MTN and scheduling point shall be assigned to the nearest scheduling point represented in the MNM. Adjustments to the real-time monitoring of the Customer scheduling point shall be made accordingly to reflect the total power consumed by that Customer scheduling point accounting for the power generated by the dispatchable generator situated downstream.</p>	For deletion since Section 5.3.2 (d) ⁴ already covers this provision

⁴ 5.3.2. The MNM may contain simplifications related to the representation of Generation and Customer Trading Nodes upon request of a Trading Participant and approved by the Market Operator, System Operator, and if necessary, the Network Service Provider. Such simplifications are listed, but not limited to the following conditions

- a) xxx;
- b) xxx;
- c) xxx; and
- d) Single Customer Trading Nodes representing an aggregate of multiple customers maybe disaggregated into several Customer Trading Nodes corresponding to the customers represented in that Trading Node. It is provided, however, that such disaggregation shall be allowed only in cases where there are appropriate real-time monitoring points that can account for the real-time withdrawal of energy in each disaggregated individual customer trading node. (emphasis supplied)

Title	Clause	Provision	Proposed Amendment	Rationale
Criteria for the Definition of MTN	6.4.6	A generating facility shall be modelled as a scheduling point.	A generating facility shall be modelled as a scheduling point.	For deletion since generating resources can have both MTNs and scheduling points
MNM	6.5	GENERATOR MTN	GENERATOR MTN <u>MARKET RESOURCE</u>	For consistency with the proposed new Section 2.1.5 (Definition of Market Resource)
Generator MTN	6.5.1	A MTN is considered a generator node if energy is supplied into that node and the direction of the power flow is from the apparatus or equipment (i.e. generator) operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	A MTN is considered a generator node if energy is supplied into that node and the direction of the power flow is from the apparatus or equipment (i.e. generator) operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	For deletion since the definition is already indicated in Section 6.3.1
Generator MTN	6.5.2	6.5.2 During the submission of offers to supply electricity, the participant generator shall specify the location of the connection point and the relevant market network node.	6.5.2 During the submission of offers to supply electricity, the participant generator shall specify the location of the connection point and the relevant market network node. <u>6.5.1 During the registration of the generator resource, the Trading Participant shall specify if the scheduling point should represent the gross MW output of the generator or at the same location as the market trading node, which is at the connection point and net of its station use. The location of the scheduling point shall be the reference point for the registered capacity, submission of generation offers and self-scheduled nominations, scheduling,</u>	Re-numbered Revised for clarity where the scheduling point shall be the reckoning or reference point capacity registration until dispatch compliance monitoring. Settlement is reckoned at the market trading node.

Title	Clause	Provision	Proposed Amendment	Rationale
			<u>dispatch, and dispatch compliance monitoring.</u>	
Generator MTN	6.5.3	6.5.3 xxx	6.5.3 <u>6.5.2</u> xxx	Re-numbered
MNM	6.6	CUSTOMER MTN	CUSTOMER MTN- <u>MARKET RESOURCE</u>	For consistency with the proposed new Section 2.1.5 (Definition of Market Resource)
Customer MTN	6.6.1	A customer node is the point where energy is withdrawn by the WESM participant and the direction of the power flow is from the network operated by the Network Service Providers, including the System Operator, to the energy consuming apparatus or equipment (i.e. load) owned by or connected to the customer trading participant.	<p>A customer node is the point where energy is withdrawn by the WESM participant and the direction of the power flow is from the network operated by the Network Service Providers, including the System Operator, to the energy consuming apparatus or equipment (i.e. load) owned by or connected to the customer trading participant.</p> <p><u>Should there be limitations for a customer resource to be modelled at the connection point (e.g. availability of real-time monitoring facilities), the Market Operator may implement simplifications and approximations to its representation in the market network model while still ensuring its consistency and accuracy with its actual connection to the grid.</u></p>	<p>For deletion since the definition is already indicated in Section 6.3.1</p> <p>To reflect current modelling practice for customer resources.</p>
MNM	6.7	BATTERY ENERGY STORAGE SYSTEM MTN	BATTERY ENERGY STORAGE SYSTEM MTN- <u>MARKET RESOURCE</u>	For consistency with the proposed new Section 2.1.5 (Definition of Market Resource)

Title	Clause	Provision	Proposed Amendment	Rationale
Battery Energy Storage System	6.7.1	A MTN is considered a battery energy storage system node if energy is injected or withdrawn through that node and the direction of the power flow is from the apparatus or equipment operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	A MTN is considered a battery energy storage system node if energy is injected or withdrawn through that node and the direction of the power flow is from the apparatus or equipment operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	Propose to delete original provision since definition is already indicated in section 6.3.1.
Battery Energy Storage System	6.7.2	6.7.2 During the submission of offers to supply or consume electricity, the participant battery energy storage system shall specify the location of the connection point and the relevant market network node.	6.7.2 During the submission of offers to supply or consume electricity, the participant battery energy storage system shall specify the location of the connection point and the relevant market network node. <u>6.7.1 During the registration of the <i>battery energy storage system resource</i>, the <i>Trading Participant</i> shall specify if the <i>scheduling point</i> should represent the gross MW output of the generator or at the same location as the <i>market trading node</i>, which is at the connection point and net of its station use. The location of the <i>scheduling point</i> shall be the reference point for the <i>registered capacity</i>, submission of <i>generation offers</i> and <i>self-scheduled nominations</i>, <i>scheduling</i>, <i>dispatch</i>, and <i>dispatch compliance monitoring</i>.</u>	Re-numbered Revised for clarity where the scheduling point shall be the reckoning or reference point capacity registration until dispatch compliance monitoring. Settlement is reckoned at the market trading node.
Battery Energy Storage System	6.7.3	6.7.3 xxx	6.7.3 <u>6.7.2</u> xxx	Re-numbered


Title	Clause	Provision	Proposed Amendment	Rationale
MNM	6.8	PUMPED-STORAGE UNIT MTN	PUMPED-STORAGE UNIT MTN <u>MARKET RESOURCE</u>	For consistency with the proposed new Section 2.1.5 (Definition of Market Resource)
Pumped-Storage Unit	6.8.1	A MTN is considered a pumped-storage unit node if the facility is a pumped-storage plant where energy can either be injected or withdrawn through that node and the direction of the power flow is from the apparatus or equipment operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	A MTN is considered a pumped-storage unit node if the facility is a pumped-storage plant where energy can either be injected or withdrawn through that node and the direction of the power flow is from the apparatus or equipment operated by the Trading Participant to the network operated by the Network Service Providers, including the System Operator.	For deletion since the definition is already indicated in Section 6.3.1
Pumped-Storage Unit	6.8.2	6.8.2 During the submission of offers to supply or consume electricity, the participant battery energy storage system shall specify the location of the connection point and the relevant market network node.	6.8.2 During the submission of offers during generation mode, the participant pumped-storage unit shall specify the location of the connection point and the relevant market network node <u>6.8.1 During the registration of the pumped-storage unit resource, the Trading Participant shall specify if the scheduling point should represent the gross MW output of the generator or at the same location as the market trading node (i.e. at the connection point, which is at the connection point and net of its station use. The location of the scheduling point shall be the reference point for the registered capacity, submission of generation offers and self-scheduled</u>	Re-numbered Revised for clarity where the scheduling point shall be the reckoning or reference point capacity registration until dispatch compliance monitoring. Settlement is reckoned at the market trading node.

Title	Clause	Provision	Proposed Amendment	Rationale
			<u>nominations, scheduling, dispatch, and dispatch compliance monitoring.</u>	
Pumped-Storage Unit	6.8.3	6.8.3 xxx	6.8.3 <u>6.8.2</u> xxx	Re-numbered
MNM	6.9	PROCEDURE FOR MTN IDENTIFICATION	PROCEDURE FOR MTN IDENTIFICATION REGISTRATION OF MARKET RESOURCES	Revised to better describe the section
Procedure for MTN Identification	6.9.2	The Market Operator and the System Operator, in coordination with the Trading Participant, shall determine the MTN based on the criteria set out in Section 6.4 - Criteria For Definition of MTN of this document.	The Market Operator and the System Operator, in coordination with the Trading Participant, shall determine the MTN <u>market resource model</u> based on the criteria <u>guidelines</u> set out in of Section 6.4 - Criteria For Definition of MTN of this document. <u>The agreed market resource model shall be determined in accordance with the procedures under the WESM Market Manual on Registration, Suspension, and De-Registration Criteria and Procedures.</u>	For consistency with the proposed new Section 2.1.5 (Definition of Market Resource)

Appendix A. Illustration of Simplified Model for Embedded Generators


Main Criteria for Simplification

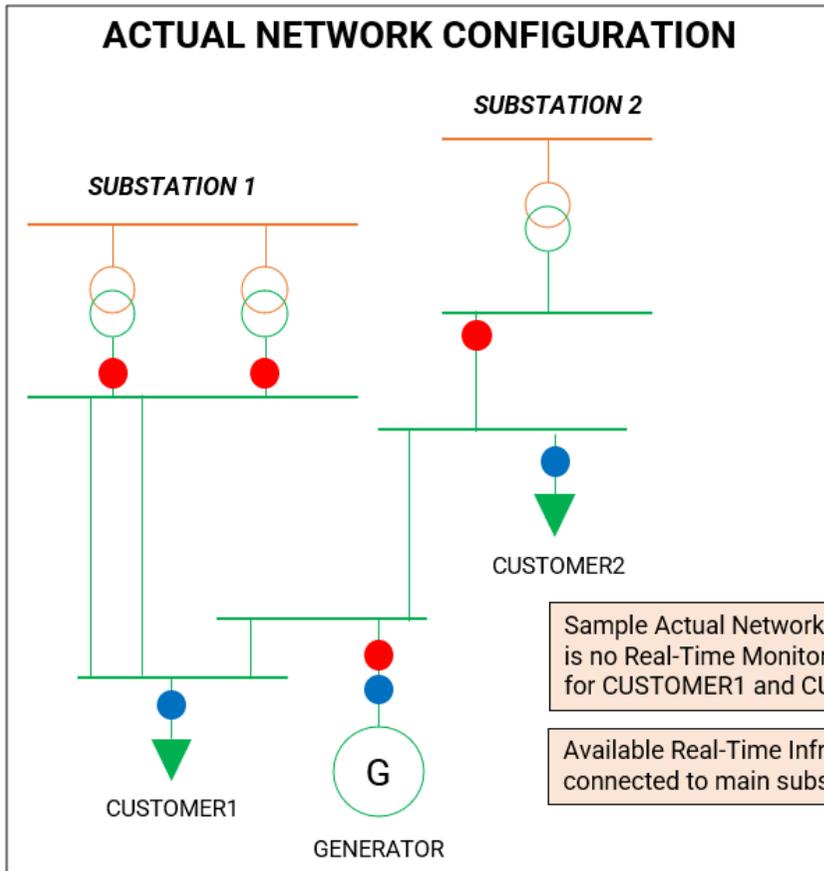Insufficient real-time monitoring adjacent to the connection points of Customer Feeders



Sample Actual Network shows there is no Real-Time Monitoring Facility for CUSTOMER1 and CUSTOMER2

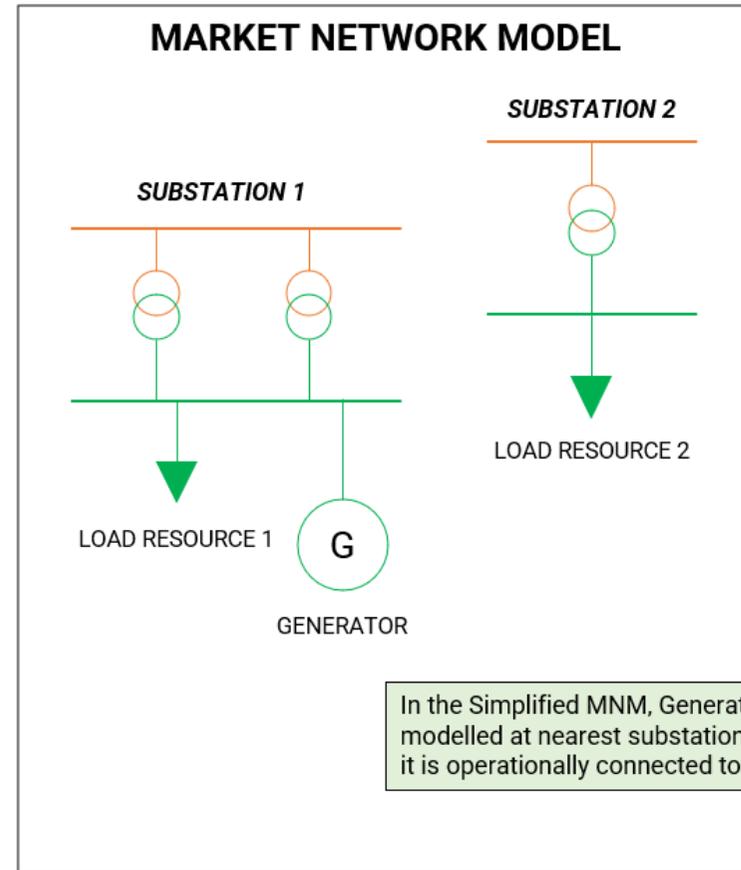Available Real-Time Infra is at feeder connected to main substation



In the Simplified MNM, Generator is modelled at nearest substation that it is operationally connected to